

MODEL F – HY–PAK  
SINGLE STATION  
PRE–CONFIGURED HYDRAULIC POWER UNIT


HYSPECO MODEL F – HY–PAK HYDRAULIC POWER UNITS

**HYSPECO ASSEMBLY NUMBER	HYSPECO PART NUMBER	SERIES	RESERVOIR CAPACITY GAL [LITERS]	ELECTRIC MOTOR HP	MAX FLOW GPM [LPM] (@1800 RPM)	MAX CONTINUOUS OPERATING PRESSURE PSI [BAR]	DIRECTIONAL VALVE MOUNTING INTERFACE	VALVE MTG. THD
C40F0003	C40–D–E–F	C	60 [228]	40	21.0 [79.8]	3000 [206.9]	D05/NG10	1/4"–20 UNC

–CONTACT HYSPECO ENGINEERING FOR FLOW AND/OR OPERATING PRESSURE CAPABILITIES OUTSIDE OF THE NOTED VALUES IN THE ABOVE TABLE.  
–THESE SYSTEMS ARE DESIGNED FOR OPERATION WITH STANDARD PETROLEUM/MINERAL BASE HYDRAULIC FLUIDS (SEE NOTE BELOW)  
–THE SYSTEMS ARE NOT DESIGNED OR RATED FOR USE WITH WATER–GLYCOL OR HIGH WATER CONTENT FLUIDS  
–MINIMUM OPERATING PRESSURE: 350 PSI [24 BAR] TO PREVENT PUMP DAMAGE, DO NOT DIVERT PUMP FLOW TO TANK (0 PSI) FOR EXTENDED PERIODS OF TIME. IF THE PUMP MUST OPERATE FOR EXTENDED PERIODS OF TIME IN A "STAND-BY" MODE, CONTACT HYSPECO ENGINEERING FOR CIRCUIT MODIFICATION REQUIREMENTS.

\*\*ORDER BY HYSPECO ASSEMBLY NUMBER

- ALL UNITS INCLUDE THE FOLLOWING STANDARD FEATURES:
- HEAVY DUTY DESIGN FOR 24/7 INDUSTRIAL APPLICATIONS
  - PAINTED AND PRE–TESTED BEFORE SHIPMENT
  - RESERVOIR W/ INTERNAL BAFFLE; CLEAN–OUT COVERS; SIGHT–GLASS W/ THERMOMETER; AND FILLER BREATHER ASSEMBLY
  - LIQUID FILLED PRESSURE GAUGE W/ SHUT–OFF
  - WELDED RISERS ON TANK SUCTION, RETURN FILTER, TEMP/LEVEL SWITCH; AND FILLER–BREATHING TANK PENETRATION POINTS
  - SAFETY RELIEF VALVE (PRESET)
  - PUMP PRESSURE COMPENSATOR CAN BE ADJUSTED TO THE MAXIMUM OPERATING PRESSURE NOTED IN THE CHART. (UNITS SHIPPED WITH COMPENSATOR SET @ 1500 PSI [103 BAR])
  - DUCTILE MANIFOLD
  - TEMP/LEVEL SWITCH; SPDT
  - REAR MOUNTED PUMP CASE DRAIN COOLER
  - TANK MOUNTED RETURN FILTER
  - SPARE RETURN FILTER REPLACEMENT ELEMENT (SHIPPED LOOSE)
  - SPARE RETURN W/ DOWN–PIPE (SAE –12 – PLUGGED)

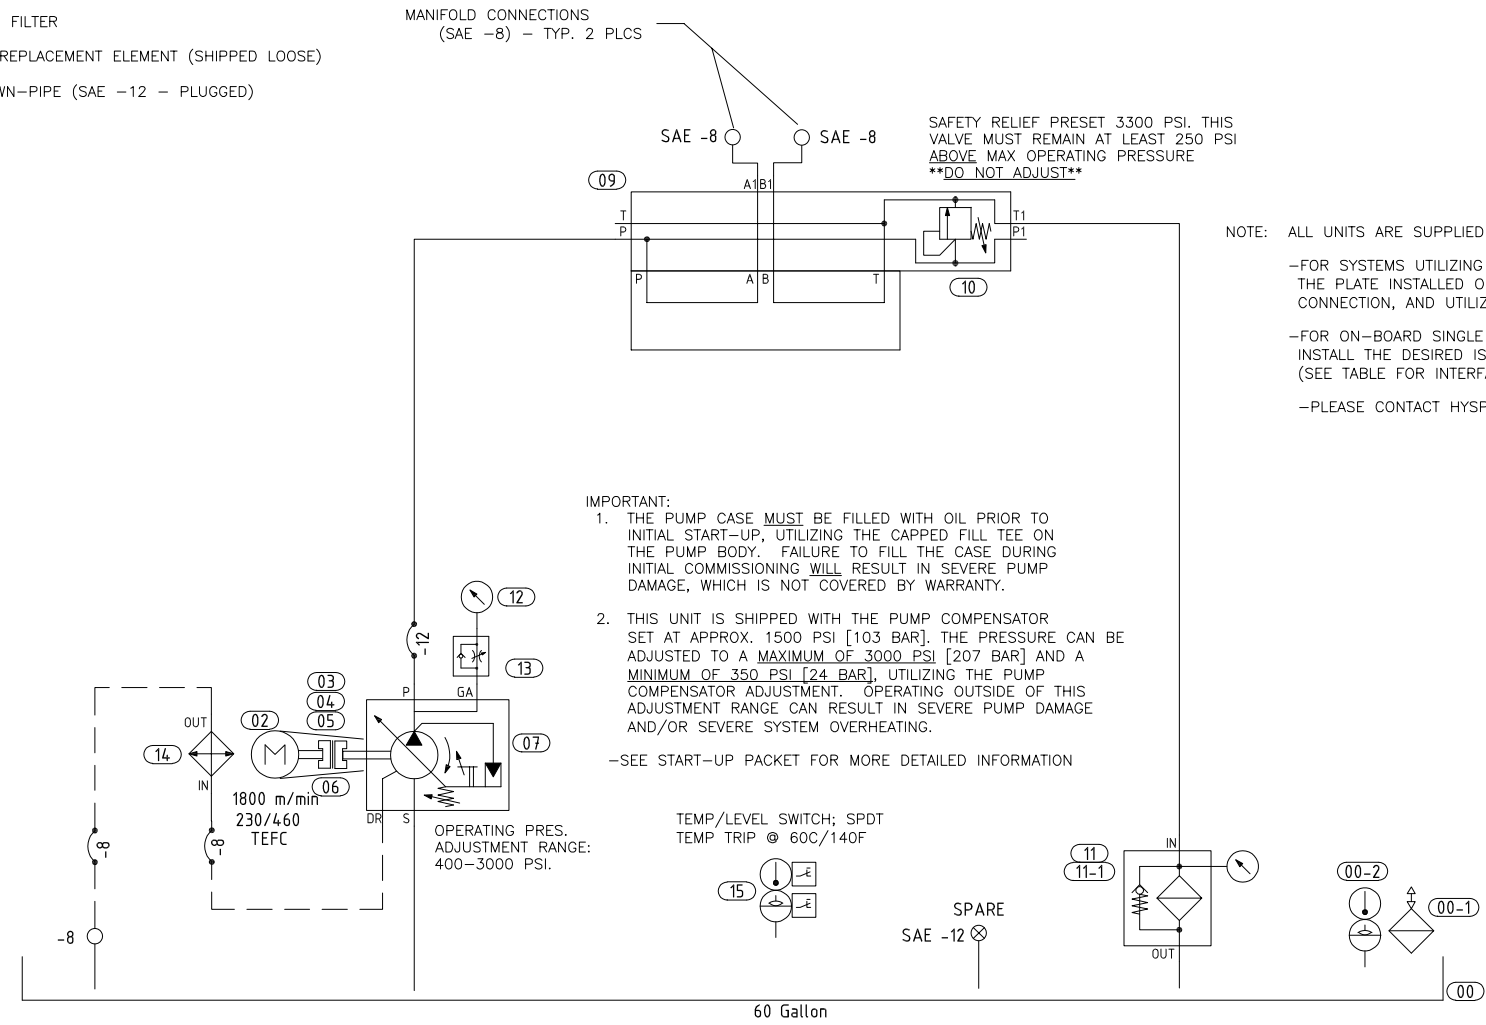

IMPORTANT:  
1. THE PUMP CASE MUST BE FILLED WITH OIL PRIOR TO INITIAL START–UP, UTILIZING THE CAPPED FILL TEE ON THE PUMP BODY. FAILURE TO FILL THE CASE DURING INITIAL COMMISSIONING WILL RESULT IN SEVERE PUMP DAMAGE, WHICH IS NOT COVERED BY WARRANTY.  
2. THIS UNIT IS SHIPPED WITH THE PUMP COMPENSATOR SET AT APPROX. 1500 PSI [103 BAR]. THE PRESSURE CAN BE ADJUSTED TO A MAXIMUM OF 3000 PSI [207 BAR] AND A MINIMUM OF 350 PSI [24 BAR], UTILIZING THE PUMP COMPENSATOR ADJUSTMENT. OPERATING OUTSIDE OF THIS ADJUSTMENT RANGE CAN RESULT IN SEVERE PUMP DAMAGE AND/OR SEVERE SYSTEM OVERHEATING.  
–SEE START–UP PACKET FOR MORE DETAILED INFORMATION

NOTE: ALL UNITS ARE SUPPLIED WITH A P–A/B–T CROSS–OVER PLATE INSTALLED ON THE MANIFOLD.  
–FOR SYSTEMS UTILIZING REMOTELY MOUNTED CONTROL VALVES, SIMPLY LEAVE THE PLATE INSTALLED ON THE MANIFOLD AND UTILIZE THE "A" PORT FOR THE SYSTEM SUPPLY (P) CONNECTION, AND UTILIZE THE "B" PORT FOR THE RETURN (T) CONNECTION.  
–FOR ON–BOARD SINGLE VALVE CONTROL, REMOVE THE COVER–PLATE FROM THE MANIFOLD AND INSTALL THE DESIRED ISO INTERFACE VALVE CONFIGURATION (VALVES SOLD SEPARATELY). (SEE TABLE FOR INTERFACE AND BOLT THREAD INFORMATION.)  
–PLEASE CONTACT HYSPECO FOR CONTROL VALVE OPTIONS THAT WILL BOLT DIRECTLY ON THE MANIFOLD.

+RS – DESIGNATES RECOMMENDED SPARE PART  
(NOTE: IF THE UNIT IS BEING UTILIZED IN A "PROCESS–CRITICAL" APPLICATION, IT IS ALSO RECOMMENDED THAT A REPLACEMENT PUMP BE CONSIDERED AS A CRITICAL SPARE PART.)

ITEM	QTY	PART #	DESCRIPTION	MANU
00	1		60 GAL RESERVOIR W/ SIGHT–GLASS & BREATHING	
00–1	1	FB–H008W	REPLACEMENT FILLER/BREATHING	
00–2	1	SLLG–05T–C	REPLACEMENT SIGHT–GLASS ASSY.	
02	1		40HP 1800RPM 230/460//380VAC 3PH 60/50HZ IC411 TEFC 324TC ELECTRIC MOTOR	WEG
03	1	M50020416DSS	MOTOR COUPLING; 2–1/8" X 1/2"KW	MAGNALOY
04	1	M50010008DSS	PUMP COUPLING; 1" X 1/4"KW	MAGNALOY
+RS 05	1	M570H5	COUPLING INSERT; (HYTREL)	MAGNALOY
06	1		MOTOR/PUMP ADAPTER	
+RS (OPTIONAL) 07	1	PD045PS02SR55BAM0R1200000 (05E–02496–5)	PISTON PUMP; (2.75 CIR)	PARKER
09	1		D03 SINGLE STATION DUCTILE MANIFOLD W/ C10–2 RELIEF CAVITY	
+RS 10	1	RAH101S50	RELIEF VALVE CARTRIDGE; 200–5000 PSI; C10–2	PARKER
11	1		TANK MOUNTED RETURN FILTER W/ VISUAL CLOGGING INDICATOR; SAE –16 PORTS	
+RS 11–1	1	946855Q	REPLACEMENT FILTER ELEMENT	PARKER
12	1		0–5000 PSI/BAR LIQUID FILLED PRESSURE GAUGE	
13	1		GAUGE SHUT–OFF W/ INTEGRAL SNUBBER	
14	1		REAR MOUNT CASE DRAIN OIL COOLER	
15	1		TEMP/LEVEL SWITCH; SPDT; TEMP TRIP @ 60C/140F	

RECOMMENDED FLUID TYPE: HIGH QUALITY PETROLEUM BASE HYDRAULIC FLUID, WITH A GOOD ANTI–WEAR ADDITIVE PACKAGE (ISO 46 OR ISO 68)  
EXAMPLE FLUIDS:  
–PARKER DuraClean™  
–MOBIL DTE 25 OR DTE 26  
–TEXACO RANDO HD46 OR HD68  
–SHELL TELLUS 46 OR 68

SYMBOL	DATE	CHANGE	BY
1	02.16.2024	ADDED 1800 RPM NOTATION TO FLOW RATING COLUMN	GWM
REVISIONS			

THIS DRAWING IS THE PROPERTY OF AND CONTAINS CONFIDENTIAL INFORMATION PROPRIETARY TO HYSPECO INC. IT IS TO BE USED ONLY FOR THE PURPOSE FOR WHICH IT WAS PROVIDED. IT IS NOT TO BE COPIED OR DISCLOSED TO OTHERS AND, UPON REQUEST, RETURNED TO HYSPECO INC.

**HYSPECO** HYSPECO, INC.  
(800) 234–1041  
TITLE: MODEL F SINGLE STA. HPU HYDRAULIC SCHEMATIC

DATE	SCALE	REVISION
02.05.2024	NONE	1
DRAWN BY	SHEET	DRAWING No.
GWM	1 OF 1	C40F0003
CHECKED BY		
APPROVED BY		